# MANUAL CALL POINT WITH SELFVERIFY - BF-501/N

Interactive fire detection systems Product Datasheet

#### **Technical specifications and instructions**

#### **Features**

- Break glass unit for use in harsh environmental
- conditions
- Weather proof
- Corrosion resistant GRP
- Protection degree IP66
- Short circuit isolator in each unit
- Automatic addressing
- Proven technology
- With SelfVerify function for reduced maintenance/testing and increased reliability
- Designed to meet the requirement of the major maritime classification societies



BF-501/N has been designed for use with Autronica's interactive fire detection systems, and comprises the SelfVerify function. This function ensures the highest grade of reliability and the lowest degree of manual testing, because all units comprising this function are automatically self-tested once every 24 hours.

The high IP degree and mechanical strength of the enclosure makes the call point suitable for outdoor applications in industrial, maritime and offshore installations.

The call point is for use in hazardous area zone 2. It must be connected to a loop driver approved for zone 2.

The call point must be installed according to local regulations which normally means along escape routes, landings and exits.

#### **Principle**

Break glass operation, releasing alarm switch. Reset when a new glass is mounted.

SelfVerify: the call point's ability to initiate alarms is regularly checked.

#### **Schedule Drawing**

No modifications permitted without reference to the Notified Body



#### **Versions**

 BF-501\* Manual call point with SelfVerify
 BF-501/EX\* Manual call point with SelfVerify. Ex ia version for use in zone 0, 1 and 2
 BF-501/N Manual call point with SelfVerify. Ex ic version for use in zone 2 only

\* See separate datasheet




Technical specifications		
Weight	1,2 kg	
Material	Glass reinforced polyester	
Colour	Red	
Voltage	10 - 27 VDC	
Current consumption, stand by:	0,3 mA	
Environm. requirement	EN 54	
Degree of protection	IP66*	
Working temperature	-25 - +70 °C	
Storage temperature	-55 - +70 °C	
Cable inlets	2 x M20	
Maintenance	Replace broken glass	
Service	Replace if faulty	
Certificates	See website	
Notified body	Nemko ID No. 0470 CSA	
Type examination certificates	NEMKO 03ATEX217X IECEx NEM 11.0017X	
Directives and standards	2014/34/EU (ATEX) EN 60079-0:2012 EN 60079-11:2012 IEC 60079-0:2011 IEC 60079-11:2011 2014/30/EU (EMC) Immunity: EN 50130-4:2011 Emission: EN 61000-6-3:2001  CAN/CSA-C22.2 No. 0-10 CAN/CSA-C22.2 No. 205-12 CAN/CSA-60079-0-11 CAN/CSA-60079-1-11 CAN/CSA-60079-1-11 CAN/CSA-C22.2 No. 60529-05  UL 464, 9th Edition UL 60079-0, 5th Edition UL 60079-1, 6th Edition UL 60079-11, 5th Edition ANSI/IEC 60529:2004 ANSI/ISA-60079-26: 2011	
Ex parameters	(Ex) II 3G Ex ic IIB T4 Gc Class I, Zone 2, AEx ic IIB T4 Gc	
	Warning: Do not rub	

<sup>\*</sup>requires approved cable glands and/or plugs of minimum the same IP level.


<b>Product Name</b>	Part number	Description
BF-501/N	116-BF-501/N	Manual call point with 2 glands (type 116-6571-011.1920)
Accessories		
	116-6571-011.1920	GLAND ST M20X1,5 PG13,5 (1 pcs)

### **Dimensions**

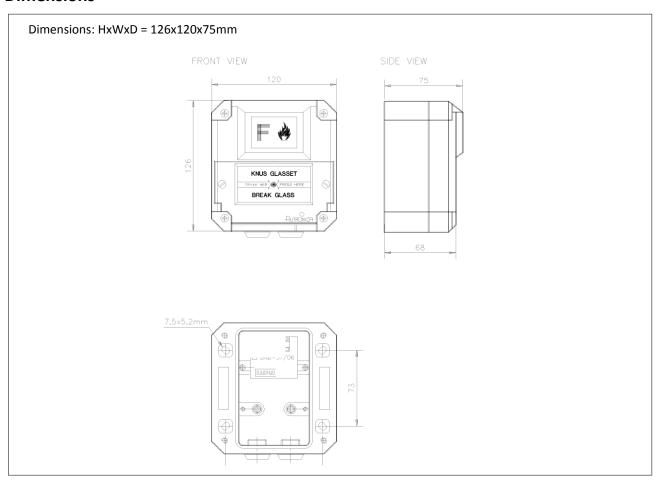

Autronica Fire and Security AS Tel.: +47 90 90 55 00 E-mail: info@autronicafire.no www.autronicafire.com Page 3

### **Connections**

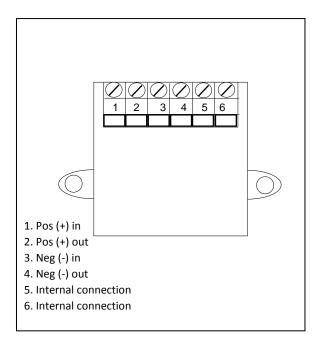

## **Control drawing**

